


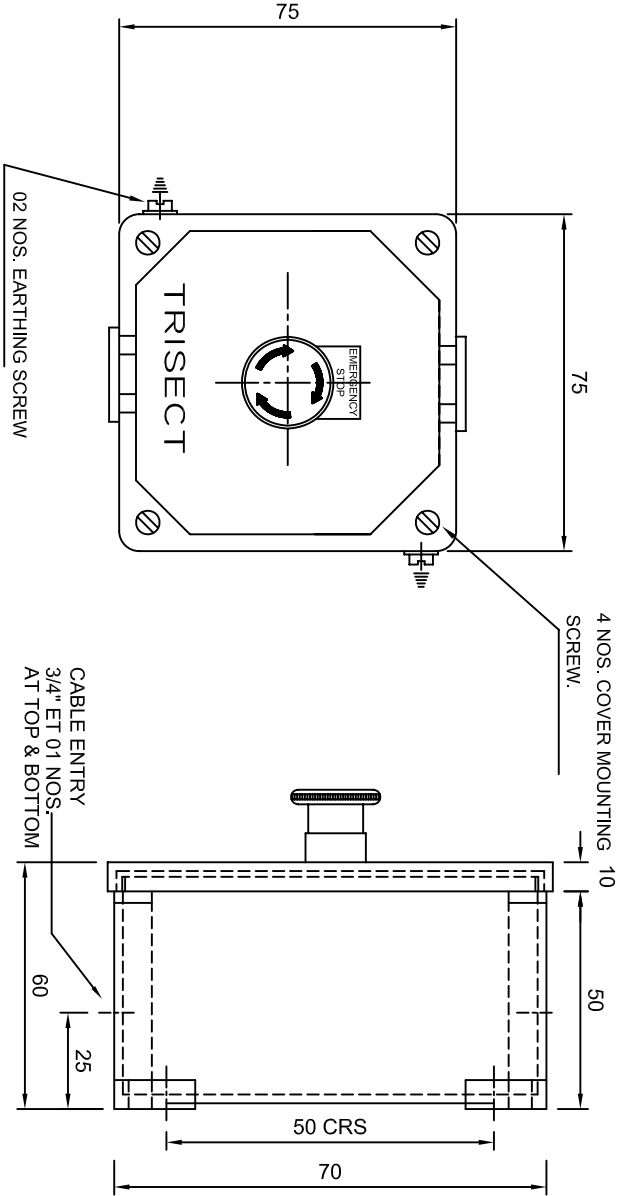

ELEVATION

GENERAL SPECIFICATIONS		
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY	
DEGREE OF PROTECTION	IP:65	
GASKETING	NEOPRENE OR EQUIVALENT.	
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE	
HARDWARES	M4 x 25 MM LONG S.S.	
FINISH	POWDER COATED SHADE RAL: 7032	
CABLE ENTRY	3/4" ET 1NO. AT TOP & 01 NO. AT BOTTOM	
PUSH BUTTONS	EMERGENCY STOP (RED) MASHROOM HEAD, STAY PUT - 1 NC CONTACT ELEMENT	

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4 mm




Authorised Dealer:

M/S. A. HARILAL & CO. PVT. LTD.
169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.
Tel: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882
E-mail: samir@aharilal.com


TITLE OF DRAWING G.A. FOR ONE WAY PB STATION
SIZE: 75 x 75

DRAWN	Mundasar	TOLERANCE	± 4 mm
CHECKED	aiwa	CAT. NO.	TS-1 (S)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.

N.T.S.	TP - 001	1 OF 1	00
--------	----------	--------	----

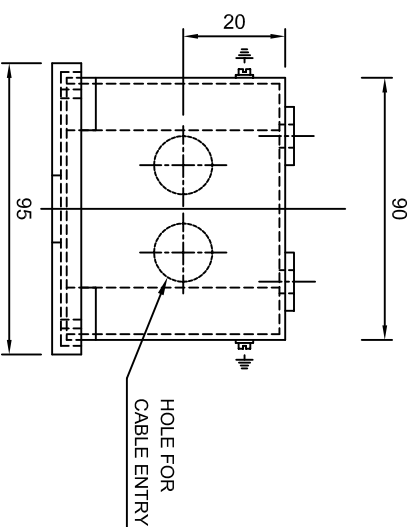

PLAN

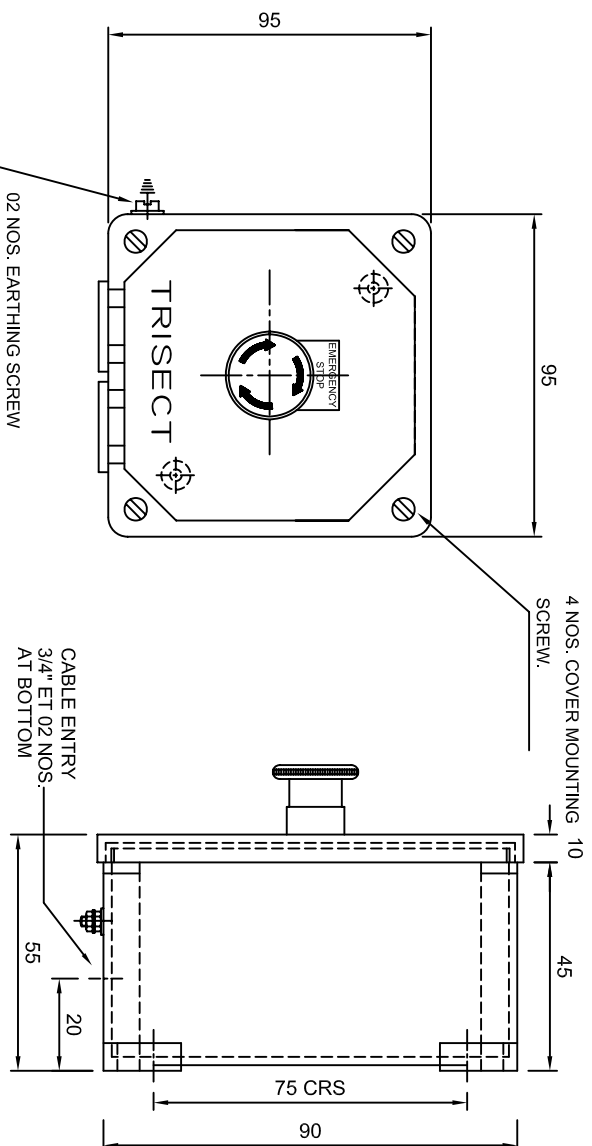

ELEVATION

GENERAL SPECIFICATIONS		
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY	
DEGREE OF PROTECTION	IP-65	
GASKETING	NEOPRENE OR EQUIVALENT.	
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE	
HARDWARES	M4 x 25 MM LONG S.S.	
FINISH	POWDER COATED SHADE RAL: 7032	
CABLE ENTRY	3/4" ET 02 NOS. AT BOTTOM	
PUSH BUTTONS	EMERGENCY STOP (RED) MASHROOM HEAD, STAY PUT - 1 NC CONTACT ELEMENT	

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4 mm



TRISECT POWER
Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 55 54, 2209 5882


E-mail: samir@aharilal.com

TITLE OF DRAWING


G.A. FOR ONE WAY PB STATION

SIZE: 100 x 100 x 55

DRAWN	Mundasar	TOLERANCE	± 4 mm
CHECKED	aiwa	CAT. NO.	TS-1 (55)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 002	1 OF 1	00

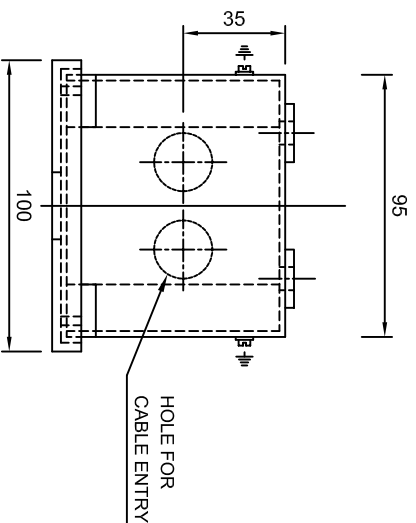

PLAN

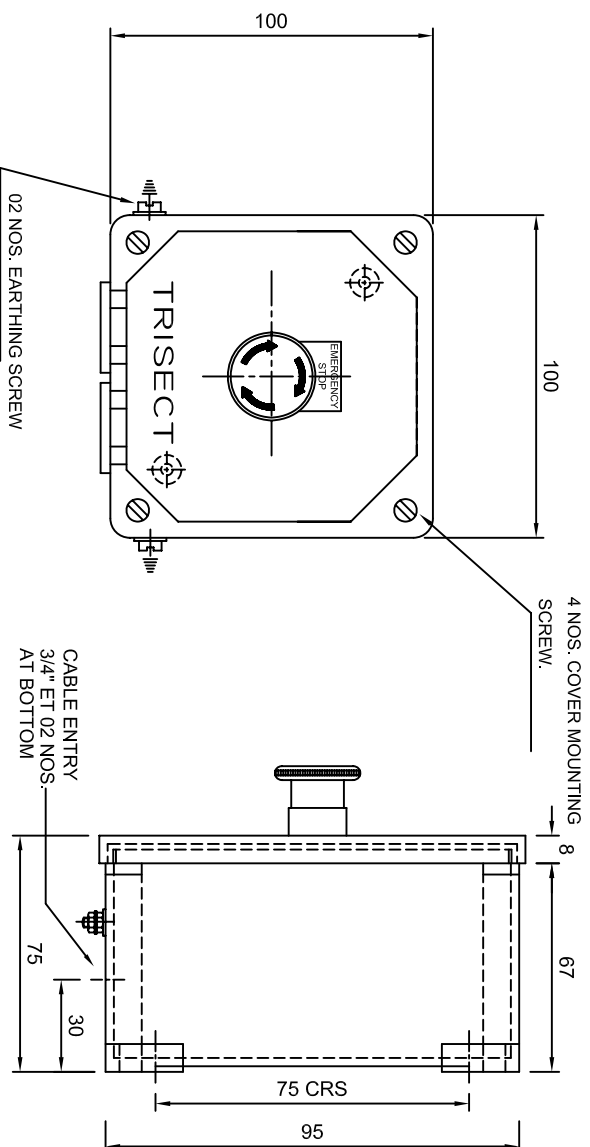

ELEVATION

GENERAL SPECIFICATIONS		
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY	
DEGREE OF PROTECTION	IP-65	
GASKETING	NEOPRENE OR EQUIVALENT.	
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE	
HARDWARES	M4 x 25 MM LONG S.S.	
FINISH	POWDER COATED SHADE RAL: 7032	
CABLE ENTRY	3/4" ET 02 NOS. AT BOTTOM	
PUSH BUTTONS	EMERGENCY STOP (RED) MASHROOM HEAD, STAY PUT - 1 NC CONTACT ELEMENT	

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4 mm



TRISECT POWER
Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 55 54, 2209 5882


E-mail: samir@aharilal.com

TITLE OF DRAWING


G.A. FOR ONE WAY PB STATION

SIZE: 100 x 100 x 75

DRAWN	Mudassar	TOLERANCE	± 4 mm
CHECKED	aiwa	CAT. NO.	TS-1 (75)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 003	1 OF 1	00

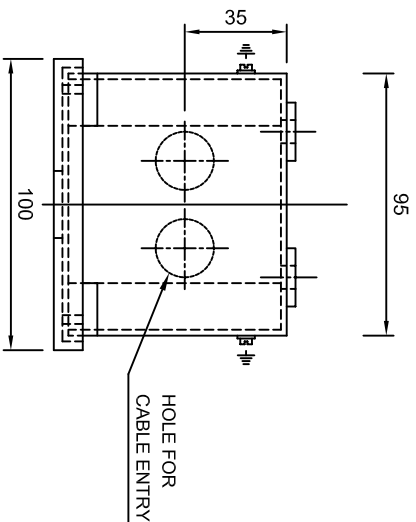

PLAN

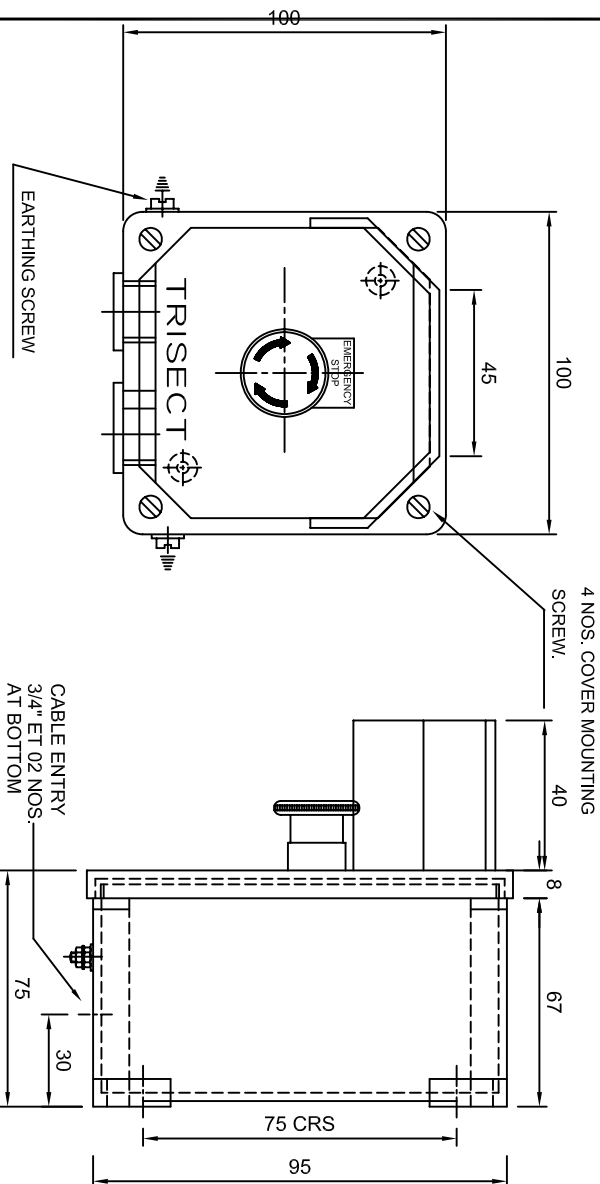

ELEVATION

GENERAL SPECIFICATIONS		
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY	
DEGREE OF PROTECTION	IP-65	
GASKETING	NEOPRENE OR EQUIVALENT.	
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE	
HARDWARES	M4 x 25 MM LONG S.S.	
FINISH	POWDER COATED OR EPOXY PAINTED, SHADE 631 OF IS:5 OR RAL-7032	
CABLE ENTRY	3/4" ET 2 NOS. FROM BOTTOM	
PUSH BUTTONS	EMERGENCY STOP (RED) MASHROOM HEAD, STAY PUT - 1 NC CONTACT ELEMENT	

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm AND ON MOUNTING CENTER DISTANCES ± 2.0 mm



TRI SECT POWER
Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.



169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882

E-mail: samir@aharilal.com

TITLE OF DRAWING **G.A. FOR ONE WAY PB STATION WITH CANOPY**
SIZE: 100 x 100 x 75

DRAWN	<i>Mundasar</i>	TOLERANCE	± 4 mm
CHECKED	aiwa	CAT. NO.	TS1 (75) C
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 004	1 OF 1	00

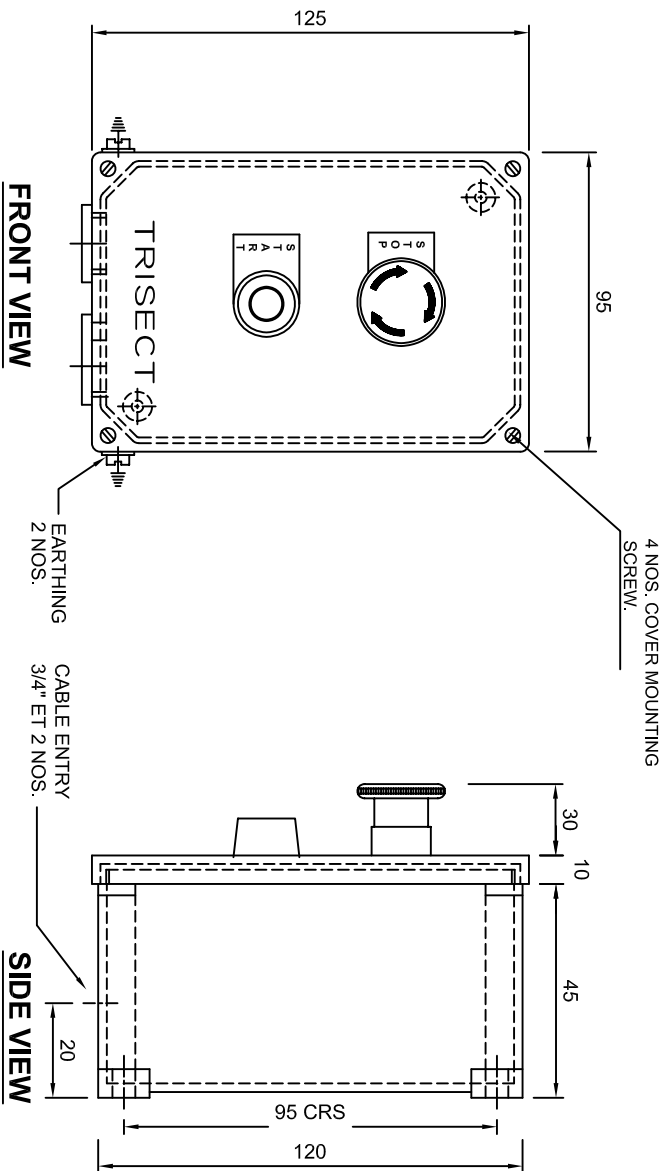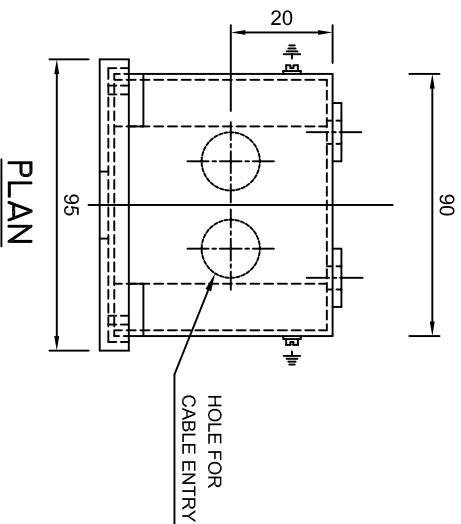

GENERAL SPECIFICATIONS		
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY	
DEGREE OF PROTECTION	IP-65	
GASKETING	NEOPRENE OR EQUIVALENT.	
EARTHING	S.S. M-4, 2 NOS. OUTSIDE	
HARDWARES	M4 x 25 MM LONG S.S.	
FINISH	POWDER COATED, SHADE RAL : 7032	
CABLE ENTRY	2 NOS. 3/4" ET AT BOTTOM SIDE.	
PUSH BUTTON	START (GREEN) AND STOP (RED) MASHROOM HEAD. STAY PUT - 1 NO + 1 NC.	

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4 mm



TRISECT POWER

Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 55 54, 2209 5882


E-mail: samir@aharilal.com

TITLE OF DRAWING


G.A. FOR TWO WAY PB STATION

SIZE: 130 x 100 x 55


DRAWN	Mundasar	TOLERANCE	± 4 MM
CHECKED	aiwa	CAT. NO.	TS-2 (55)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 005	1 OF 1	00

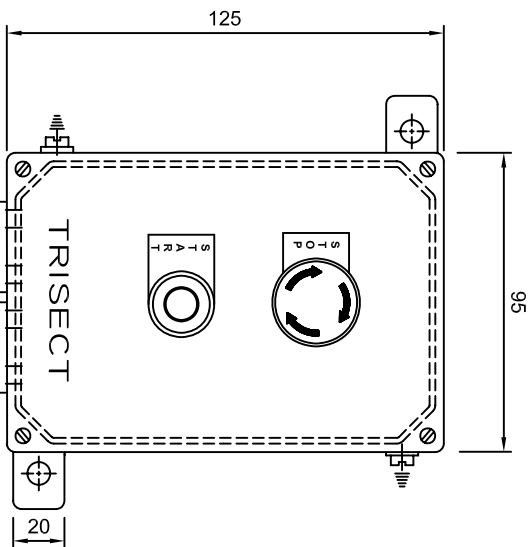

FRONT VIEW

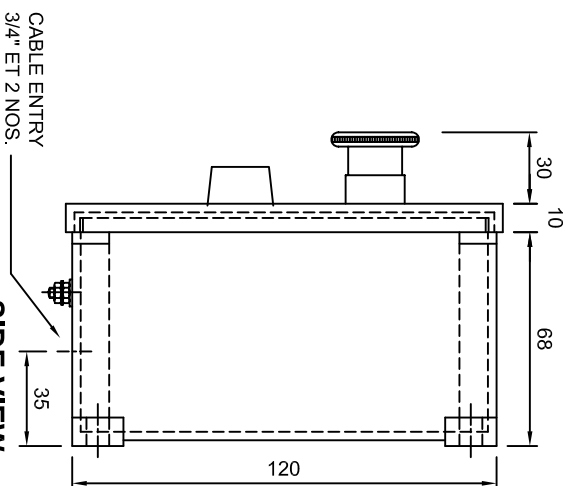

SIDE VIEW

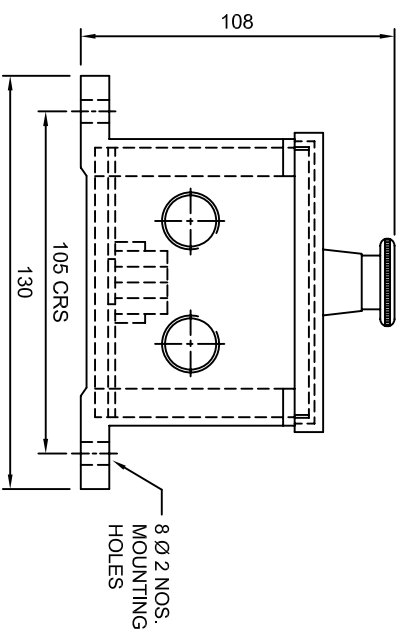

BOTTOM VIEW

GENERAL SPECIFICATIONS

MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY		
DEGREE OF PROTECTION	IP-65		
GASKETING	NEOPRENE OR EQUIVALENT.		
EARTHING	S.S. M-4, 2 NOS. OUTSIDE		
HARDWARES	M4 x 25 MM LONG S.S.		
FINISH	POWDER COATED, SHADE RAL : 7032		
CABLE ENTRY	2 NOS. 3/4" ET AT BOTTOM SIDE.		
PUSH BUTTON	START (GREEN) AND STOP (RED) MASHROOM HEAD. STAY PUT - 1 NO + 1 NC.		

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm
AND ON MOUNTING CENTER DISTANCES ± 2.0 mm



TRISECT POWER
Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel: 91 - 22 - 2208 5553, 2208 5554, 2209 5882


E-mail: samir@aharilal.com

TITLE OF DRAWING


G.A. FOR TWO WAY PB STATION

SIZE: 130 x 100 x 75


DRAWN	Mundasar	TOLERANCE	± 2.5 %
CHECKED	aiwa	CAT. NO.	TS-2 (75)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 006	1 OF 1	00

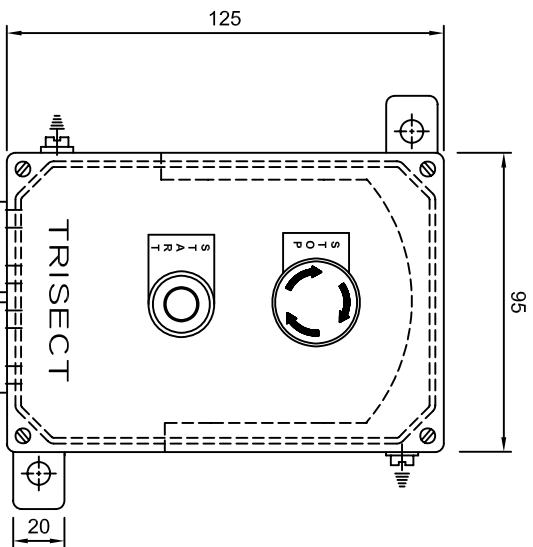

FRONT VIEW

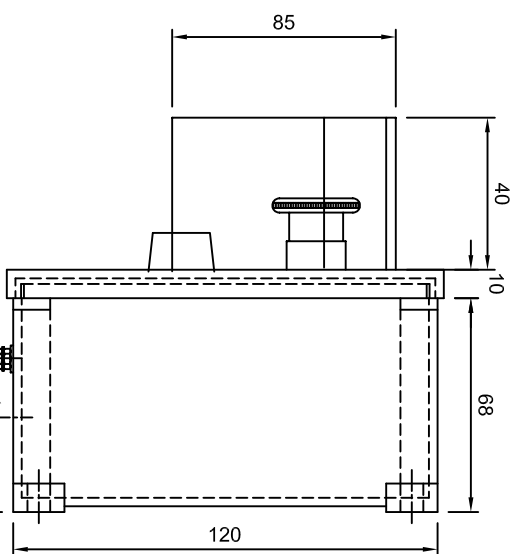

SIDE VIEW

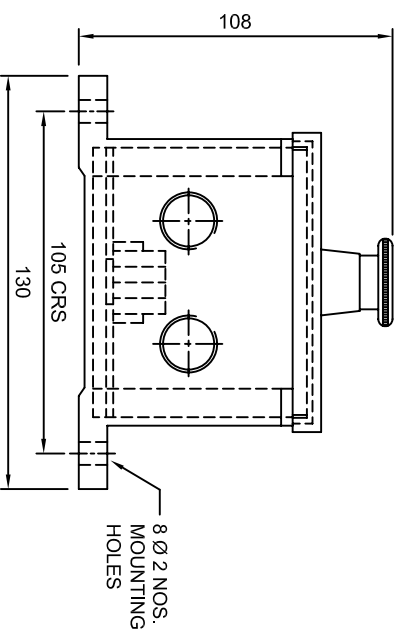

BOTTOM VIEW

GENERAL SPECIFICATIONS			
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY		
DEGREE OF PROTECTION	IP-65		
GASKETING	NEOPRENE OR EQUIVALENT.		
EARTHING	S.S. M-4, 2 NOS. OUTSIDE		
HARDWARES	M4 x 25 MM LONG S.S.		
FINISH	POWDER COATED, SHADE RAL : 7032		
CABLE ENTRY	2 NOS. 3/4" ET AT BOTTOM SIDE.		
PUSH BUTTON	START (GREEN) AND STOP (RED) MASHROOM HEAD. STAY PUT - 1 NO + 1 NC.		

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm
AND ON MOUNTING CENTER DISTANCES ± 2.0 mm



TRISECT POWER
Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.



169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel: 91 - 22 - 2208 55 53, 2208 55 54, 2209 5882

E-mail: samir@aharilal.com

TITLE OF DRAWING **G.A. FOR TWO WAY PB STATION
WITH CANOPY**
SIZE: 130 x 100 x 75

DRAWN	Mundasar	TOLERANCE	± 4 MM
CHECKED	aiwa	CAT. NO.	TS-2 (75) C
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 007	1 OF 1	00

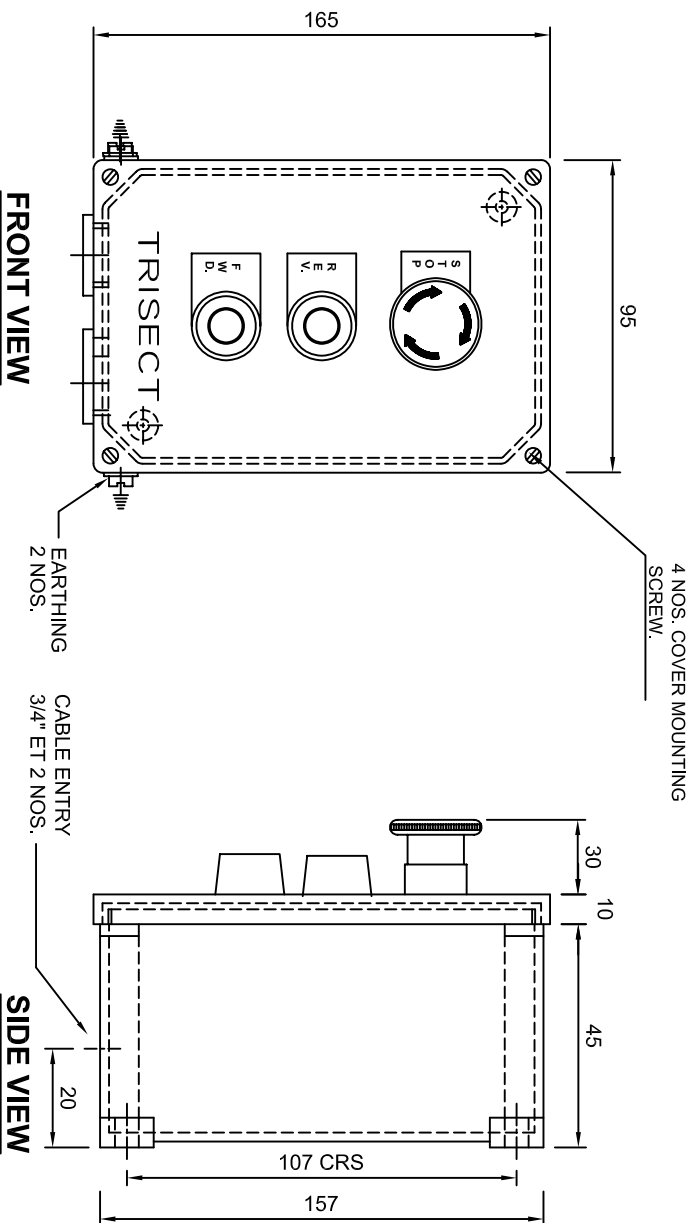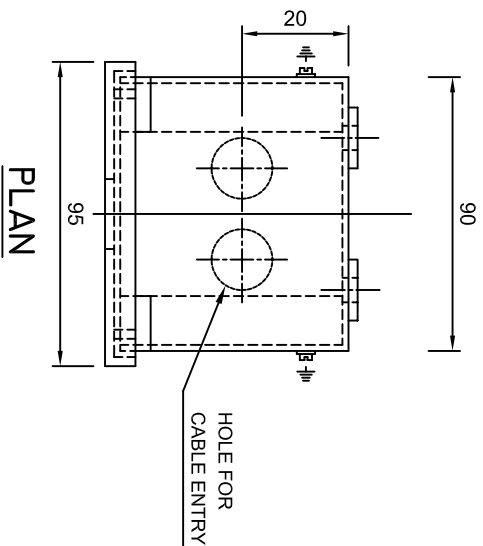

GENERAL SPECIFICATIONS	
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP:65
GASKETING	NEOPRENE OR EQUIVALENT.
EARTHING	S.S. M-4, 2 NOS. OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	POWDER COATED, SHADE RAL : 7032
CABLE ENTRY	2 NOS. 3/4" ET AT BOTTOM SIDE.
PUSH BUTTON	REVERSE (YELLOW), FORWARD (BLUE) AND STOP (RED) MASHROOM HEAD, STAY PUT WITH 1NO + 1NO + 1NC

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4 mm



TRISECT POWER
Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882


E-mail: samir@aharilal.com

TITLE OF DRAWING

G.A. FOR THREE WAY PB STATION

SIZE: 160 x 100 x 55

DRAWN	<i>Mudassar</i>	TOLERANCE	± 4 MM
CHECKED	aiwa	CAT. NO.	TS-3 (55)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 008	1 OF 1	00

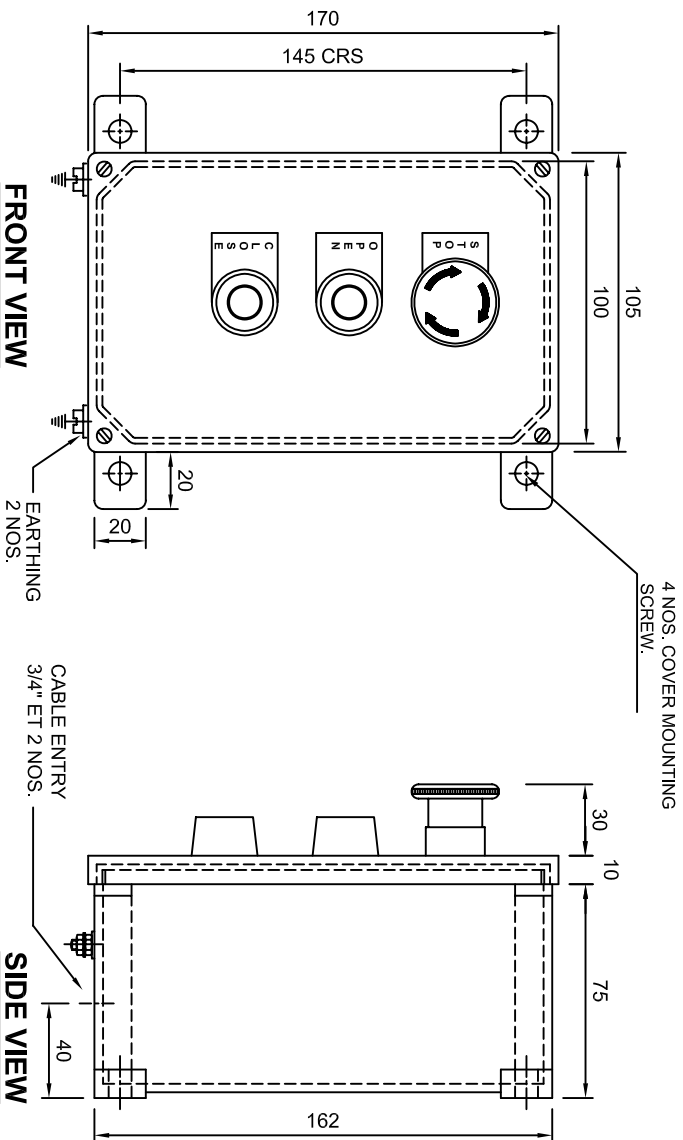

GENERAL SPECIFICATIONS		
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY	
DEGREE OF PROTECTION	IP-65	
GASKETING	NEOPRENE OR EQUIVALENT.	
EARTHING	S.S. M-4, 2 NOS. OUTSIDE	
HARDWARES	M4 x 25 MM LONG S.S.	
FINISH	POWDER COATED, SHADE RAL: 7032	
CABLE ENTRY	2 NOS. 3/4" ET AT BOTTOM SIDE.	
PUSH BUTTON	OPEN (YELLOW), CLOSE (BLUE) AND STOP (RED) MASHROOM HEAD, STAY PUT WITH 1NO + 1NO + 1NC	


NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm



TRISECT POWER
Authorized Dealer:
M/S. A. HARILAL & CO. PVT. LTD.
 169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.
Tel/fax: 91 - 22 - 2208 55 53, 2208 55 54, 2209 58 82
E-mail: saaniv@adharilal.com

TITLE OF DRAWING G.A. FOR THREE WAY PB STATION			
SIZE: 160 x 100 x 75			
DRAWN	Mudassar	TOLERANCE	± 4 MM
CHECKED	aiwa	CAT. NO.	TS-3 (75)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 009	1 OF 1	00

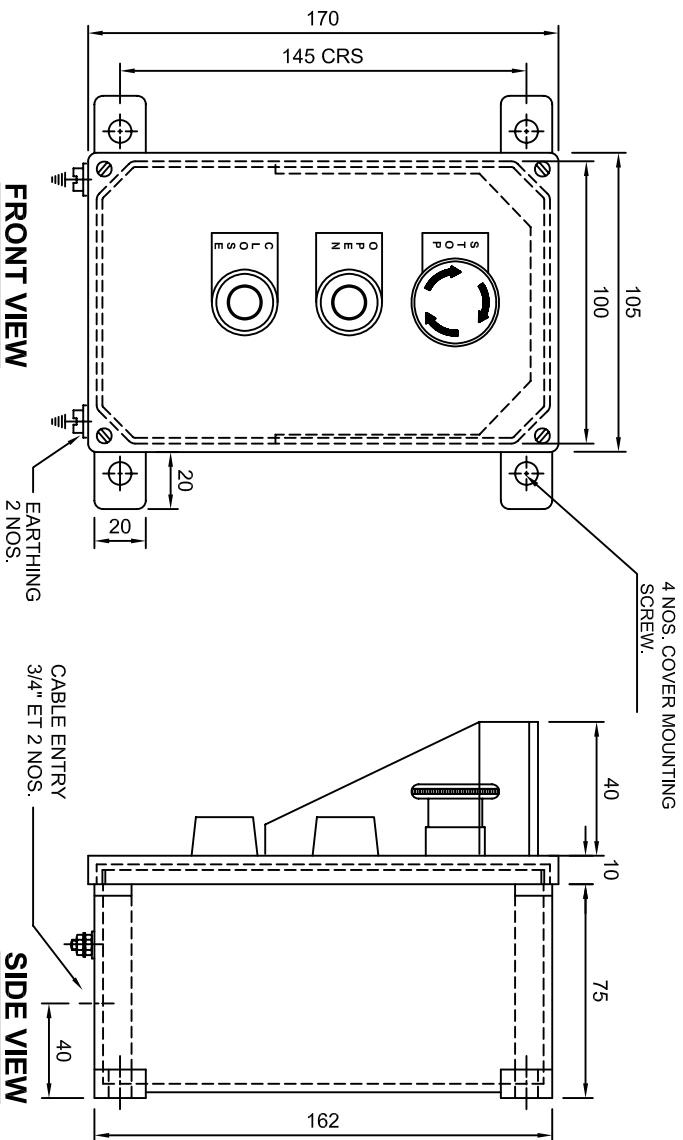

GENERAL SPECIFICATIONS		
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY	
DEGREE OF PROTECTION	IP-65	
GASKETING	NEOPRENE OR EQUIVALENT.	
EARTHING	S.S. M-4, 2 NOS. OUTSIDE	
HARDWARES	M4 x 25 MM LONG S.S.	
FINISH	POWDER COATED, SHADE RAL: 7032	
CABLE ENTRY	2 NOS. 3/4" ET AT BOTTOM SIDE.	
PUSH BUTTON	OPEN (YELLOW), CLOSE (BLUE) AND STOP (RED) MASHROOM HEAD, STAY PUT WITH 1NO + 1NO + 1NC	

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm



TRISECT POWER

Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.



169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/fax: 91 - 22 - 2208 55 53, 2208 55 54, 2209 58 82

E-mail: samir@aharilal.com

TITLE OF DRAWING **G.A. FOR THREE WAY PB STATION WITH CANOPY**
 SIZE: 160 x 100 x 75

DRAWN	<i>Muddassar</i>	TOLERANCE	± 4 MM
CHECKED	aiwa	CAT. NO.	TS-3 (75) C
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 010	1 OF 1	00

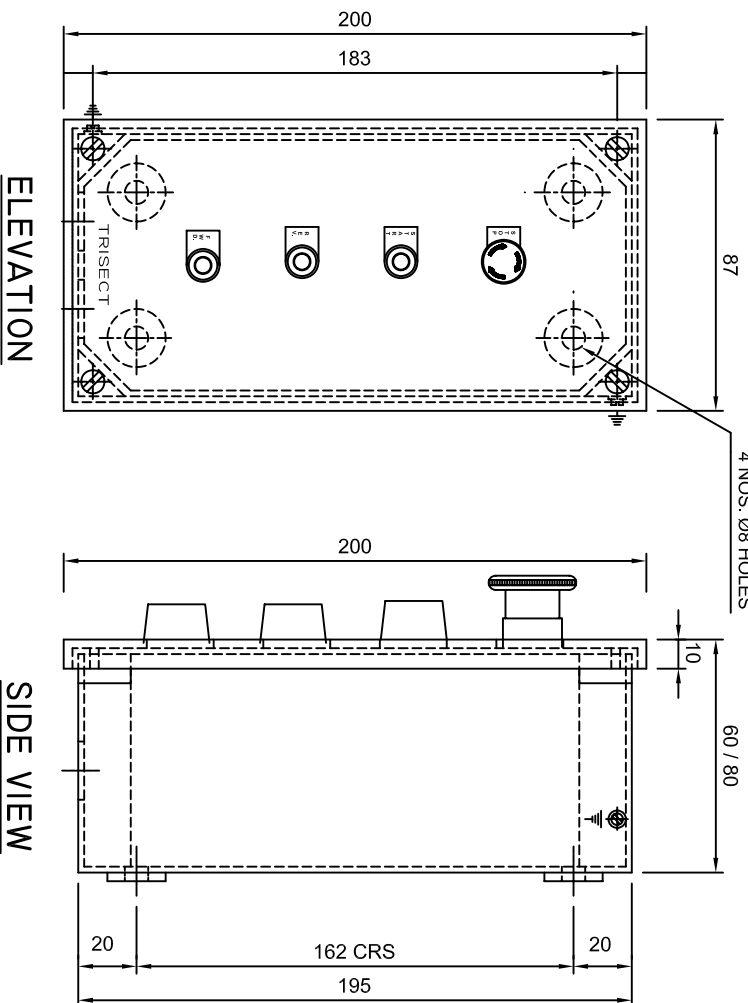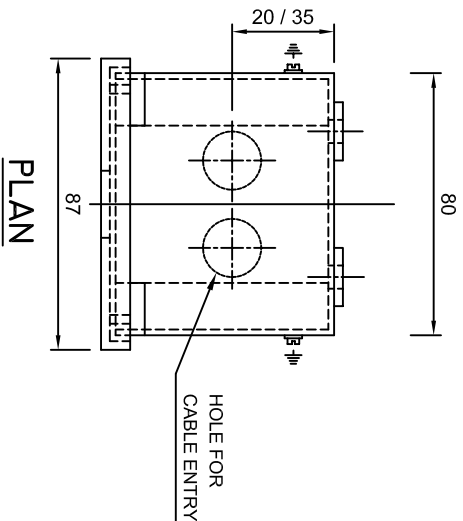

GENERAL SPECIFICATIONS	
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP-65
GASKETING	NEOPRENE OR EQUIVALENT.
EARTHING	S.S. M-4, 2 NOS. OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	POWDER COATED SHADE RAL: 7032
CABLE ENTRY	3/4" ET 2 NOS. FROM BOTTOM
PUSH BUTTONS	START (GREEN), REVERSE (YELLOW), FORWARD (BLUE) AND STOP (RED) MASHROOM HEAD, STAY PUT - 3 NO + 1 NC.

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm AND ON MOUNTING CENTER DISTANCES ± 2.0 mm



TRISECT POWER

Authorized Dealer:


M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.


Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882

E-mail: semitr@aharilal.com

TITLE OF DRAWING		G.A. FOR FOUR WAY PB STATION	
DRAWN		SIZE - 200 x 100 x 55 / 75	
CHECKED	aiwa	TOLERANCE	± 4 MM
APPROVED	PS	CAT. NO.	TS-4 (55 / 75)
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 011	1 OF 1	00

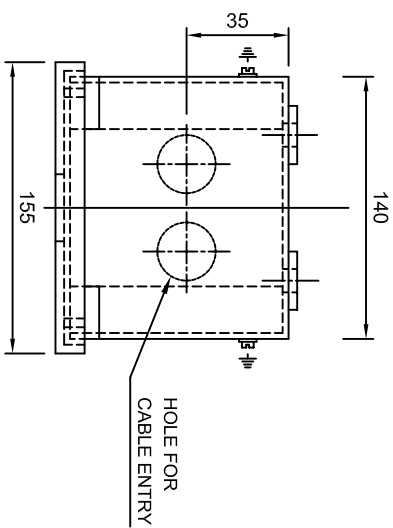

PLAN

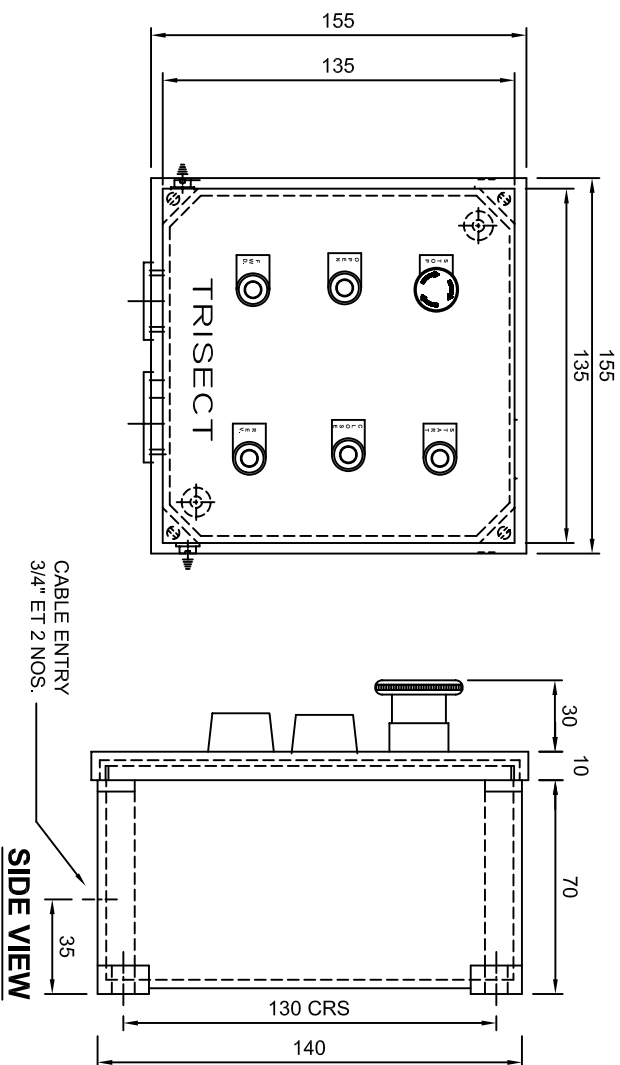

FRONT VIEW

SIDE VIEW

GENERAL SPECIFICATIONS

MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP:65
GASKETING	NEOPRENE OR EQUIVALENT.
EARTHING	S.S. M-4, 2 NOS. OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	POWDER COATED SHADE : RAL : 7032
CABLE ENTRY	02 NOS. 3/4" ET AT BOTTOM
PUSH BUTTONS	UP TO 6 NOS. OF 22.5 MMØ

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm



TRISECT POWER

Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882


E-mail: samir@aharilal.com

TITLE OF DRAWING


G.A. OF SIX WAY PB STATION

SIZE : 160 x 160 x 75

DRAWN	<i>Mudassar</i>	TOLERANCE	± 4 MM
CHECKED	<i>aiwa</i>	CAT. NO.	TS 6
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 12	1 OF 1	00

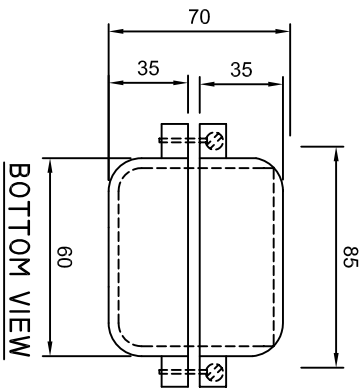

BOTTOM VIEW

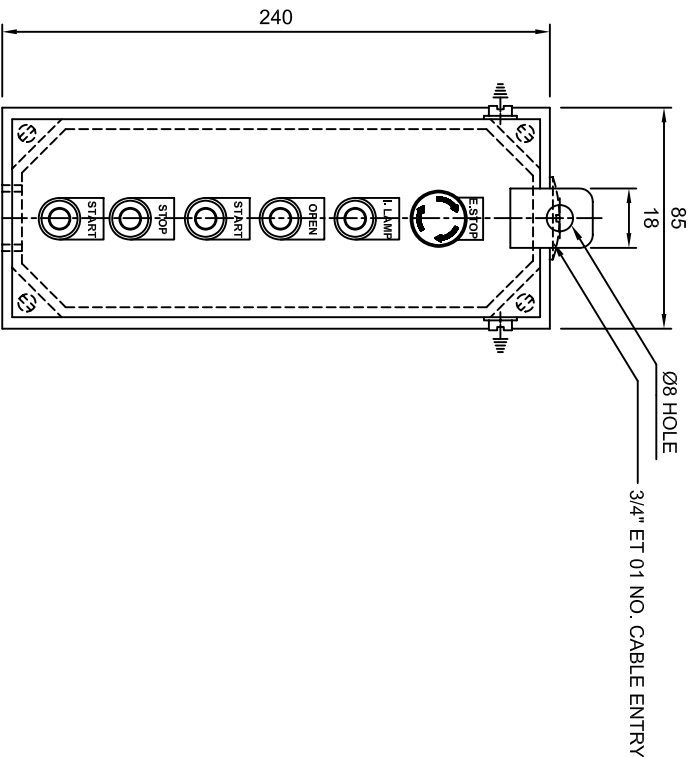

ELEVATION

GENERAL SPECIFICATIONS

MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY		
DEGREE OF PROTECTION	IP:65		
GASKETING	NEOPRENE .		
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE		
HARDWARES	M4 x 25 MM LONG S.S.		
FINISH	POWDER COATED, SHADE RAL : 7032		
CABLE ENTRY	3/4" ET 1 NO. FROM TOP		
PUSH BUTTONS (TEKNIC MAKE)	E :STOP (RED), L. LAMP (AMBER), OPEN (YELLOW), START (BLUE), STOP (RED), START (GREEN) WITH 1 NO + 1 NC EACH.		

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm
AND ON MOUNTING CENTER DISTANCES ± 2.0 mm



TRISECT POWER

Authorised Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882


E-mail: amir@aharilal.com

TITLE OF DRAWING


G.A. OF SIX WAY STATION LONG

SIZE: 240 x 85 x 70


DRAWN	<i>Mudassar</i>	TOLERANCE	± 2.5 %
CHECKED	aiwa	CAT. NO.	TPS-6 (L)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 14	1 OF 1	00

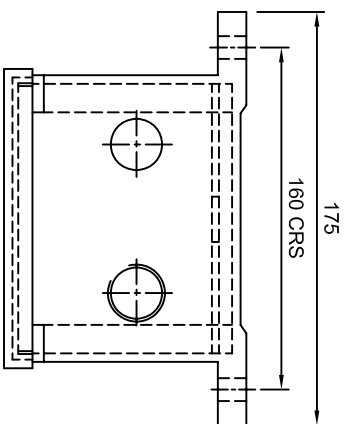

PLAN

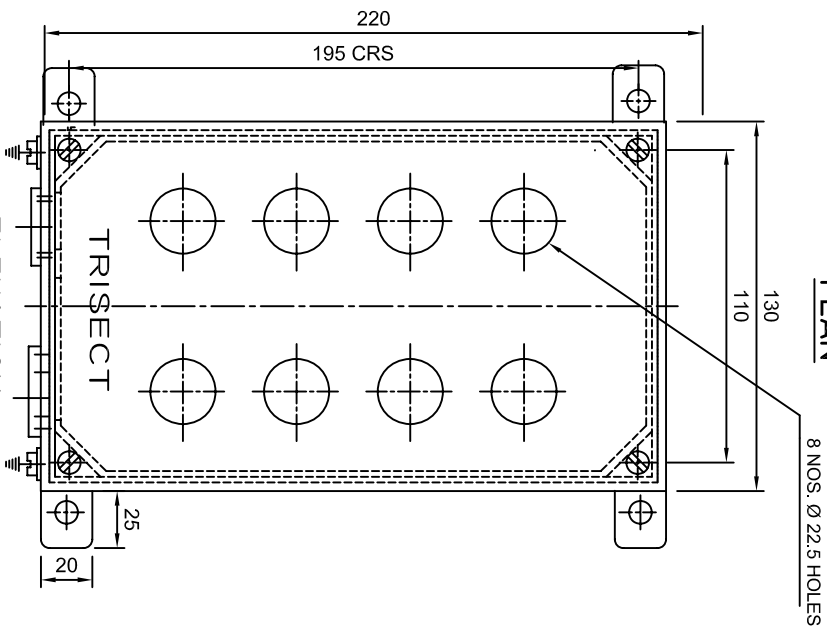

ELEVATION

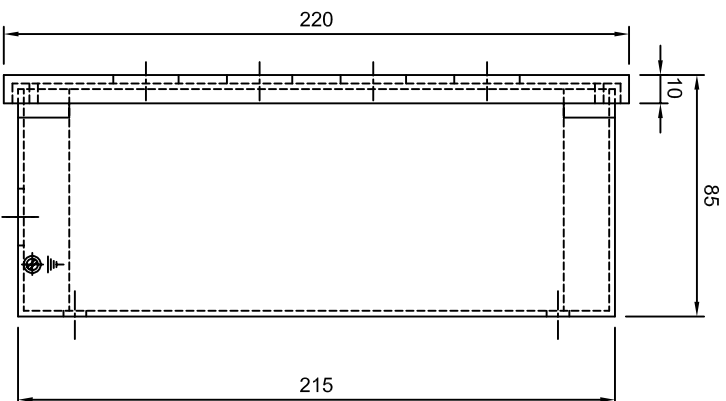

SIDE VIEW

GENERAL SPECIFICATIONS	
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP:65
GASKETING	NEOPRENE OR EQUIVALENT.
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	POWDER COATED SHADE RAL : 7032
CABLE ENTRY	3/4" ET 2 NOS. FROM BOTTOM.
PUSH BUTTONS	8 NOS. PUSH BUTTONS OF 22.5MM DIA.

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm



TRISECT POWER

Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.


Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882

E-mail: samir@aharilal.com


TITLE OF DRAWING

G.A. OF EIGHT WAY PB STATION
SIZE - 220 x 130 x 85

DRAWN	<i>shudasaar</i>	TOLERANCE	± 4MM
CHECKED	<i>aiwa</i>	CAT. NO.	TS 8
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 15	1 OF 1	00

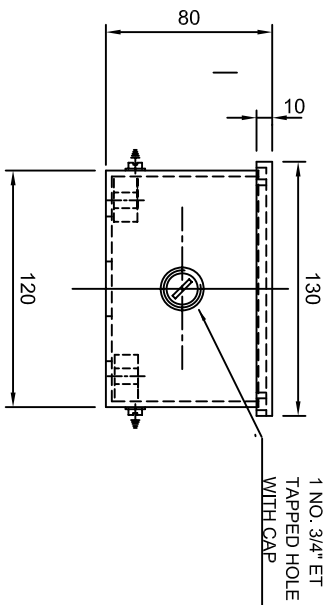

TOP VIEW

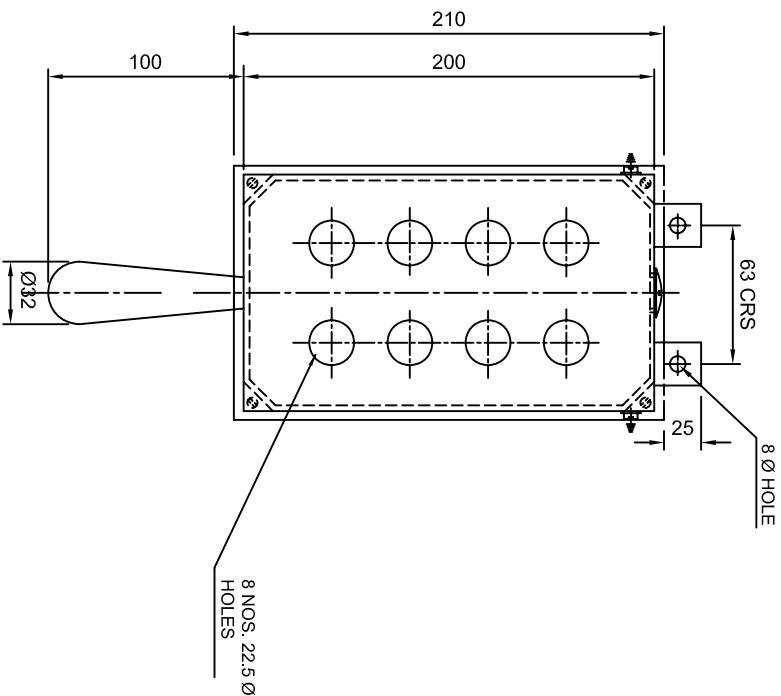

FRONT VIEW

GENERAL SPECIFICATIONS

MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP:65
GASKETING	NEOPRENE OR EQUIVALENT.
EARTHING	S.S. M-4, 2 NOS. OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	POWDER COATED SHADE RAL: 7032
CABLE ENTRY	1 NO. 3/4" ET ON TOP & 02 NOS. LEGS FOR SUSPENSION.
PUSH BUTTONS	8 NOS. OF 22.5 MMØ

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm




TRISECT POWER

Authorized Dealer:
M/S. A. HARILAL & CO. PVT. LTD.
 169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.
Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882
E-mail: samir@aharilal.com


TITLE OF DRAWING **G.A. OF 8 WAY PENDENT STATION**

SIZE: 220 x 130 x 85

DRAWN	<i>Mudassar</i>	TOLERANCE	± 2.5 %
CHECKED	aiwa	CAT. NO.	TPS - 8
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 16	1 OF 1	00

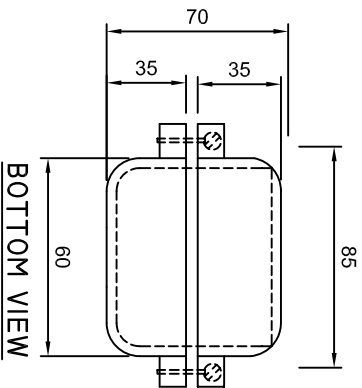

BOTTOM VIEW

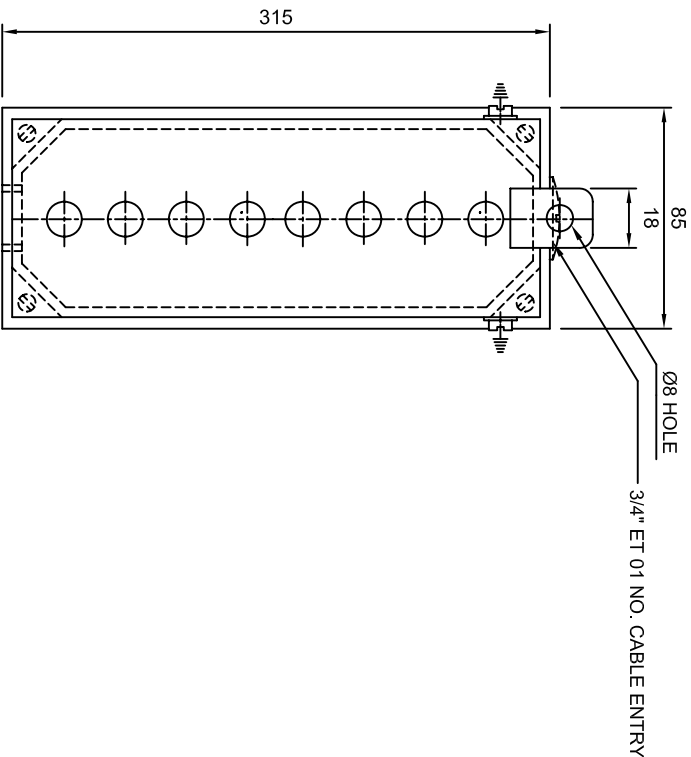

ELEVATION

GENERAL SPECIFICATIONS	
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP:65
GASKETING	NEOPRENE .
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	POWDER COATED, SHADE RAL : 7032
CABLE ENTRY	3/4" ET 1 NO. FROM TOP
PUSH BUTTONS	8 NOS. OF 22.5 MMØ

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm



TRISECT POWER

Authorised Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882


E-mail: amir@aharilal.com

TITLE OF DRAWING


G.A. OF EIGHT WAY STATION LONG

SIZE: 315 x 85 x 70

DRAWN	<i>Mudassar</i>	TOLERANCE	± 2.5 %
CHECKED	aiwa	CAT. NO.	TPS-8 (L)
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 17	1 OF 1	00

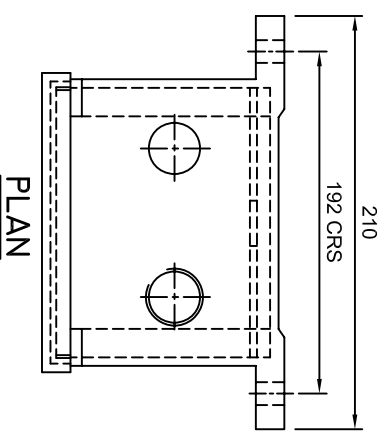

PLAN

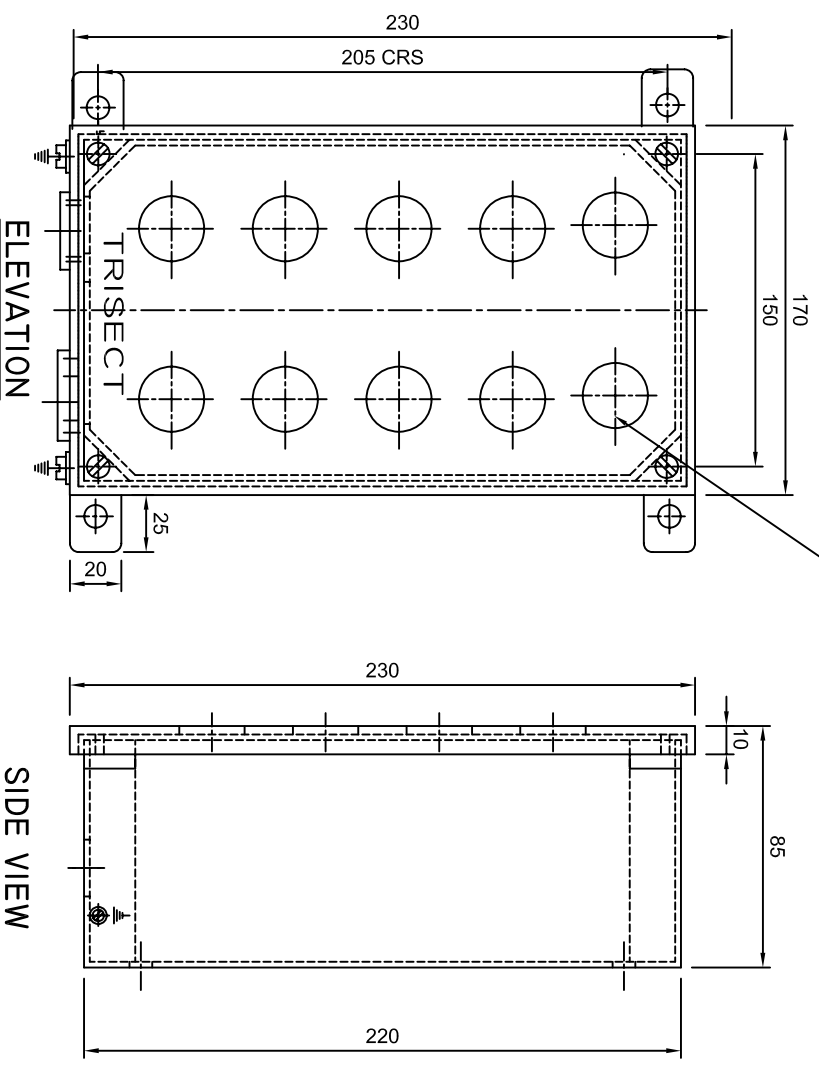

ELEVATION

SIDE VIEW

GENERAL SPECIFICATIONS			
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY		
DEGREE OF PROTECTION	IP:65		
GASKETING	NEOPRENE OR EQUIVALENT.		
EARTHING	M-4 S.S. 2 NOS. PROVIDED OUTSIDE		
HARDWARES	M4 x 25 MM LONG S.S.		
FINISH	POWDER COATED SHADE RAL : 7032		
CABLE ENTRY	3/4" ET 2 NOS. FROM BOTTOM.		
PUSH BUTTONS	10 NOS. PUSH BUTTONS OF 22.5MM DIA.		

NOTES

- 01. DO NOT SCALE THE DRAWING.
- 02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
- 03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
- 04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm




TRIASECT POWER
Authorized Dealer:
M/S. A. HARILAL & CO. PVT. LTD.
169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.
Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882
E-mail: samir@aharilal.com

TITLE OF DRAWING


G.A. OF TEN WAY PB STATION

SIZE - 230 x 170 x 85

DRAWN	<i>shudasaar</i>	TOLERANCE	± 4MM
CHECKED	aiwa	CAT. NO.	TS 10
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 18	1 OF 1	00

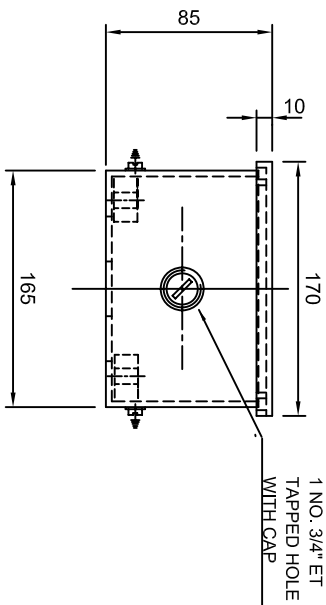

TOP VIEW

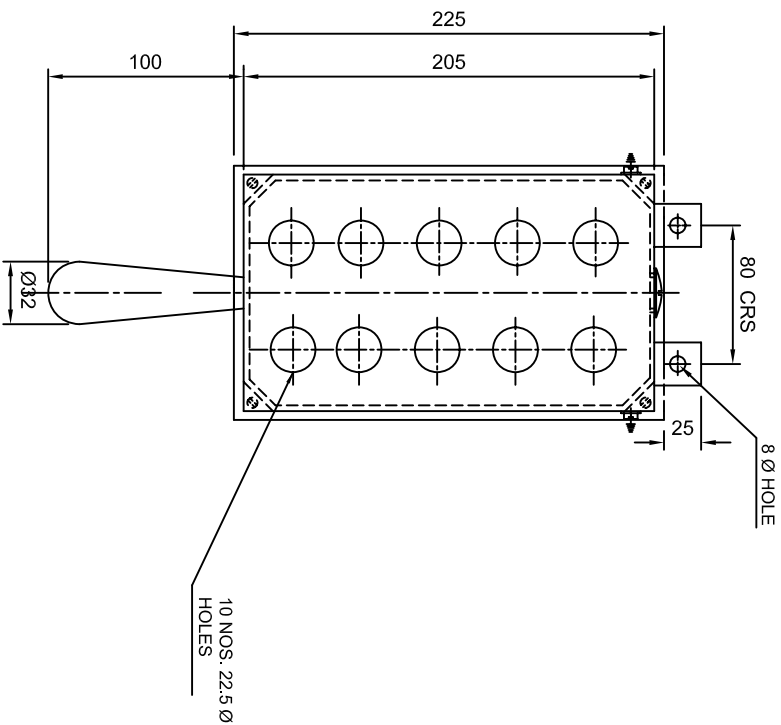

FRONT VIEW

GENERAL SPECIFICATIONS

MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP:65
GASKETING	NEOPRENE OR EQUIVALENT.
EARTHING	S.S. M-4, 2 NOS. OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	POWDER COATED SHADE RAL: 7032
CABLE ENTRY	1 NO. 3/4" ET ON TOP & 02 NOS. LEGS FOR SUSPENSION.
PUSH BUTTONS	10 NOS. OF 22.5 MMØ

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm



TRISECT POWER

Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.


Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882

E-mail: samir@aharilal.com

TITLE OF DRAWING G.A. OF 10 WAY PENDENT STATION

SIZE: 230 x 170 x 85

DRAWN	<i>Mudassar</i>	TOLERANCE	± 2.5 %
CHECKED	aiwa	CAT. NO.	TPS - 10
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP - 19	1 OF 1	00

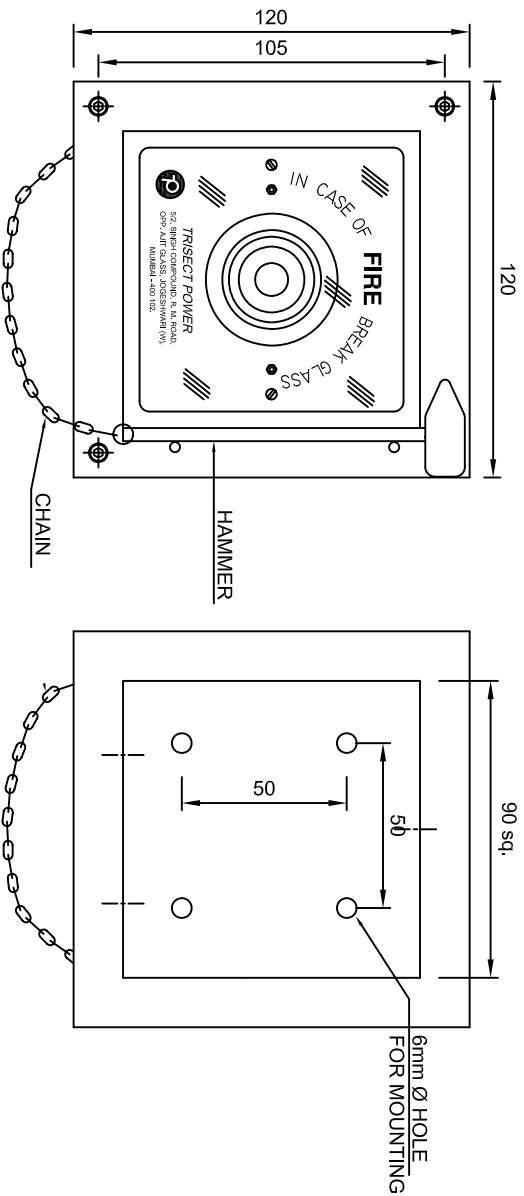

GENERAL SPECIFICATIONS	
MATERIAL OF CONSTRUCTION	CAST ALUMINIUM ALLOY
DEGREE OF PROTECTION	IP:65
GASKETING	NEOPRENE OR EQUIVALENT.
EARTHING	S.S. M-4, 1 NO. OUTSIDE
HARDWARES	M4 x 25 MM LONG S.S.
FINISH	P.O. RED. 532 OF IS: 5
CABLE ENTRY	2 NOS. 3/4" ET AT BOTTOM SIDE.
GLASS	80 x 80 x 2 MM THICK PLAIN GLASS.
PUSH BUTTON	30.5MM DIA WITH 1NO + 1NC CONTACT
GROSS WEIGHT	1.75 KGS. APPROX.

NOTES

01. DO NOT SCALE THE DRAWING.
02. ALL DIMENSIONS ARE IN MMS UNLESS OTHERWISE INDICATED.
03. SPECIFICATIONS WILL BE CHANGED AS PER CLIENT'S REQUIREMENT.
04. TOLERANCE ON OVERALL DIMENSIONS ARE ± 4.0 mm



TRISECT POWER

Authorized Dealer:

M/S. A. HARILAL & CO. PVT. LTD.

169, K.S. Marg (Lohar Chawl), Mumbai - 400 002.

Tel/Fax: 91 - 22 - 2208 55 53, 2208 5554, 2209 5882

E-mail: samir@aharilal.com

TITLE OF DRAWING

G.A. OF MCP WITH CHAIN & HAMMER

DRAWN	Mudassar	TOLERANCE	± 4 MM
CHECKED	aiwa	CAT. NO.	FA-MCP-1
APPROVED	PS		
SCALE	DRAWING NO.	SHEET NO.	REV. NO.
N.T.S.	TP-20	1 OF 1	00